

NEW WORK NOTE:

1. REMOVE ABANDONED DRINKING FOUNTAIN DRAIN LINE DOWN THROUGH FLOOR TO BASEMENT. REMOVE AND REPAIR WALL AS REQUIRED TO REMOVE DRAIN. IN FILL CONCRETE FLOOR WHERE DRAIN LINE WAS REMOVED. REPAINT WALL TO MATCH EXISTING.



GENERAL NOTES

1. ALL WORK SHALL BE COMPLETED IN ACCORDANCE WITH LOCAL, STATE AND FEDERAL CODES. WORK MUST BE CONFORM TO DIVISION 15 AS APPLICABLE OF THE FEDERAL AVIATION ADMINISTRATION PROJECT SPECIFIC CONSTRUCTION SPECIFICATIONS UNLESS NOTED OTHERWISE ON THE DRAWINGS.
2. CONTRACTOR SHALL VERIFY CLEARANCES OF EXISTING PIPE AND ELEVATIONS AND NEW PIPE-ROUTE AND TIE-INS PRIOR TO INSTALLATION.
3. CONTRACTOR SHALL EXERCISE CAUTION DURING SITE FABRICATIONS AND INSTALLATION TO INSURE NO INTERFERENCE WITH OPERATIONS OR OPERATING EQUIPMENT. ANY WORK TO BE COMPLETED IN THE CONCURRENT WORK AREAS TO BE FULLY COORDINATED WITH THE RESIDENT ENGINEER(RE) PRIOR TO BEGINNING WORK. ALL WORK PERFORMED IS TO BE ISOLATED AS TO ENSURE NO DUST, DEBRIS AND VAPORS, ETC. ENTER OPERATING SPACES.
4. EQUIPMENT SHALL BE AS SCHEDULED ON DRAWINGS, WHERE ACCEPTABLE. ALTERNATIVE MANUFACTURERS ARE LISTED IN THE SPECIFICATION. EQUIPMENT SHALL BE EQUAL QUALITY AND CAPACITY AS THE EQUIPMENT SCHEDULED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY ARRANGEMENT CHANGES REQUIRED TO ACCOMMODATE USE OF ALTERNATE EQUIPMENT.
5. ALL EQUIPMENT AND PIPING SHALL BE PROVIDED WITH THE SEISMIC RESTRAINTS IN ACCORDANCE WITH INTERNATIONAL BUILDING CODES(2003) FOR A SEISMIC USE GROUP III. SOIL PROPERTY SITE CLASS D; FOR THE JACKSONVILLE FLORIDA LOCATION.
6. PROVIDE DUST BARRIERS FOR PROTECTION OF EQUIPMENT. DUST BARRIER LOCATIONS SHALL BE SUBMITTED FOR APPROVAL TO THE RE PRIOR TO CONSTRUCTION.
7. ALL NEW SANITARY SEWER PIPING SHALL BE PVC AND INSTALLED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS.
8. PIPE HANGERS AND SUPPORTS SHALL BE IN ACCORDANCE WITH SECTION 15140 OF THE SPECIFICATION.
9. PIPE SUPPORT SHALL BE SPACED AT A MAXIMUM OF 10'-0" C/C.
10. ALL PIPES PASSING THROUGH FLOOR SHALL BE PROVIDED WITH PIPE SLEEVES.
11. PROVIDE FIRE RATED SEALANTS AT PIPE PENETRATIONS THROUGH FIRE RATED ASSEMBLIES AND SMOKE BARRIERS. FIRE SEAL OPENINGS LEFT IN EXISTING FIRE RATED ASSEMBLIES & SMOKE BARRIERS WHERE PIPING IS REMOVED. MAINTAIN RATINGS OF ALL EXISTING FIRE & SMOKE BARRIERS, INCLUDING FLOORS, FIRE WALLS & SMOKE PARTITIONS. PROVIDE SCHEDULE 40 PIPE SLEEVES FOR ALL PENETRATIONS AND FIRE-SEAL.

LEGEND

- 1.////// EXISTING WORK TO BE DEMOLISHED.

1 FIRST FLOOR, SANITARY SEWER PIPING DEMOLITION

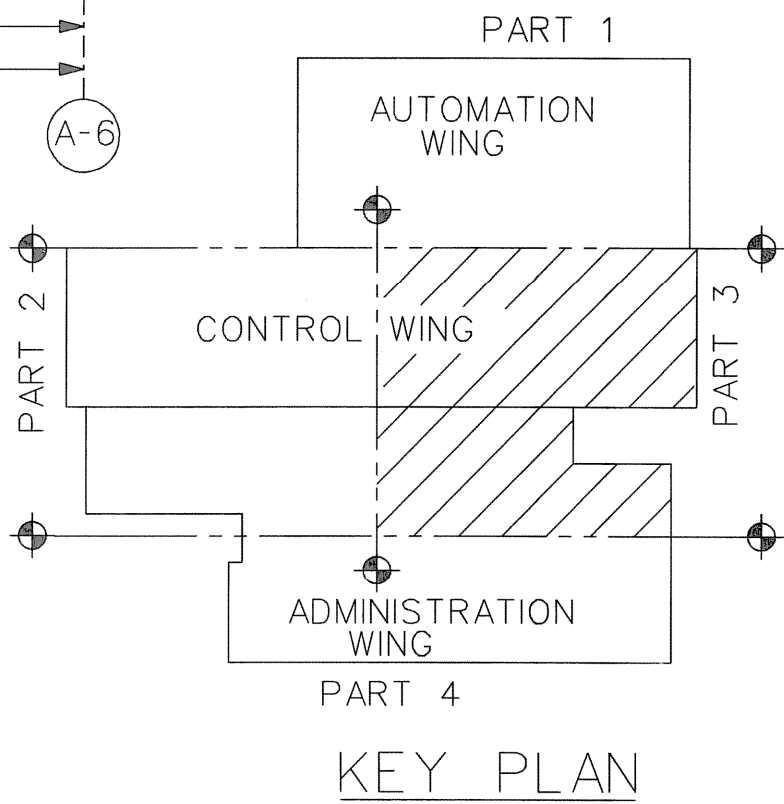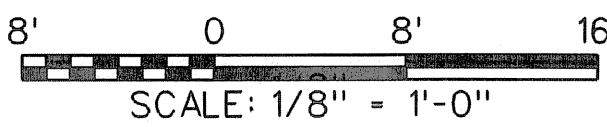

A	12/15/2008	ENGINEERING REVISION (R. ESTRADA) NX5				622533	12/08/2008	20		
REV	APPROVED DATE	DESCRIPTION				JCN	REDLINE DATE	APVD		
DEPARTMENT OF TRANSPORTATION FEDERAL AVIATION ADMINISTRATION ATO - TECHNICAL OPERATIONS EASTERN SERVICE AREA ARTCC STORM WATER PUMPS AND SEWER SYSTEM REPLACEMENT PROJECT SANITARY SEWER PIPING,FIRST FLOOR,DEMO HILLIARD JACKSONVILLE CENTER FL										
REVIEWED BY:		SUBMITTED BY ORIGINAL SIGNED BY:				APPROVED BY ORIGINAL SIGNED BY:				
		<i>Christopher G.Richard</i>				<i>Roberto Estrada,for</i>				
PROJECT ENGINEER		MGR: ENGINEERING - ATLANTA				622533				
DESIGNED		CR	ISSUED BY				DATE	06/26/2008	JCN	622533
DRAWN		DS	ENGINEERING SERVICES				DRAWING NO		ZJX-D-622533-M02	
CHECKED		ENROUTE/FSS						REV		A